

BACK TO BASICS: DUCT DESIGN

Matthew Low, M.AIRAH, CPEng
15 MAY 2013

Back to Basics: Duct Design


- Quick Introduction
- Duct Sizing Tools and Methods
- Recommended Duct Velocities and Noise Effects
- Duct Fitting Pressure Losses
- Do and Don'ts of Duct Design
- Duct Applications
- AS 4254

Quick Introduction


A “Good” Duct Design is a Balance between

- Application (Design Intent)
- Reliability (Maintenance Cost)
- Manufacturing Costs (Capital Cost)
- Pressure Loss (Operational and Energy Cost)
- Acoustics (Environmental Cost)
- Air Balancing (Commissioning Cost)

Duct Sizing Tools

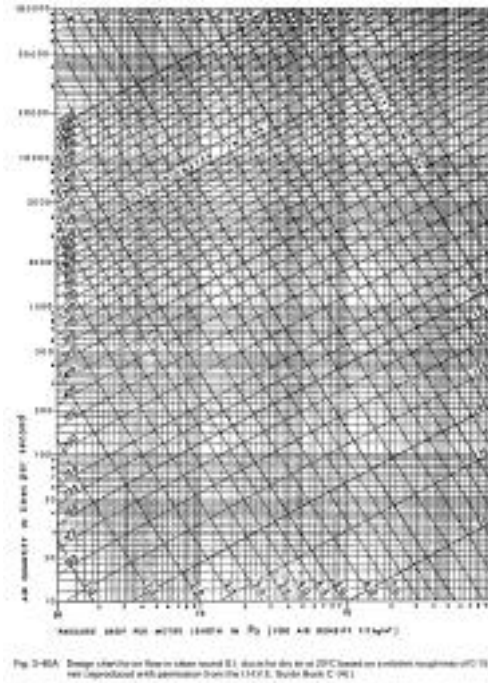

OR

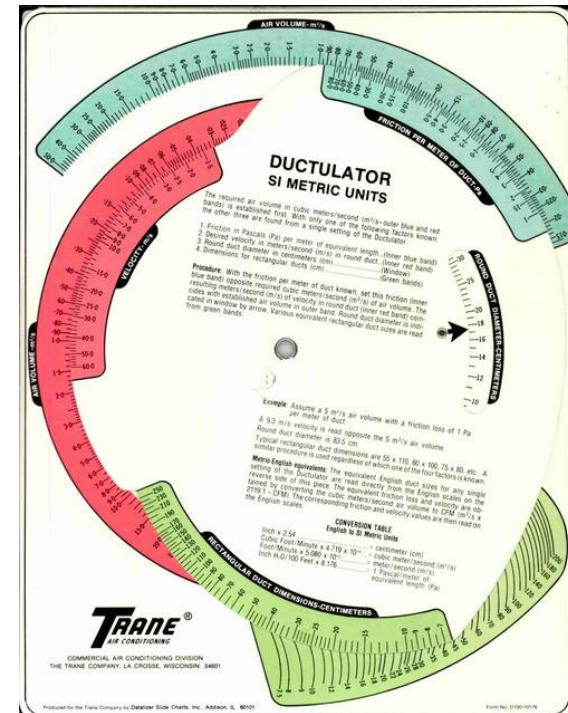

Duct Sizing Chart
AIRAH DA3 Duct Design Manual

Ductulator (Manual/Digital)
Manufacturers/Programs

Duct Sizing Methods

Methods	Description Summary	Pros	Cons
Velocity Reduction	<ul style="list-style-type: none"> • Base on Experience • $Q=VA$ (Continuity equation) 	<ul style="list-style-type: none"> • Simplest 	<ul style="list-style-type: none"> • Not standard • Not completely balanced
Constant Pressure Gradient	<ul style="list-style-type: none"> • Also called Equal Friction • In Pa/m Straight duct • Higher Pa/m used 	<ul style="list-style-type: none"> • Very Simple 	<ul style="list-style-type: none"> • Considerable dampening required
Static Regain	<ul style="list-style-type: none"> • Supply air only • Decrease in velocity pressure branch or fitting • Offsets friction loss in succeeding section of duct • Fixing 1st Segment with methods above 	<ul style="list-style-type: none"> • Lower system pressure loss • Lower Energy consumption • Less Noise issues in take offs 	<ul style="list-style-type: none"> • Larger duct sizes • Increased capital cost • Increased spatial requirements
Balanced Pressure Drop	<ul style="list-style-type: none"> • Any method above initially • Determine the index run • Resize to ensure pressure loss similar to index 	<ul style="list-style-type: none"> • Better pressure balanced system • Small duct sizes • Reduced capital and spatial costs 	<ul style="list-style-type: none"> • Tedious Calculations • Higher velocities at take offs may be noisy • Dampening of Larger ducts may be as or more noisy
T-Optimisation	<ul style="list-style-type: none"> • ASHRAE Fundamentals • Operation and Capital Cost optimisation focused 	<ul style="list-style-type: none"> • Simple • Best Economical Sizing Method 	<ul style="list-style-type: none"> • Very tedious calculations with simulations • Spatial costs neglected

Recommended Duct Velocities and Noise Effects

Required Level	NR	Riser Velocity m/s	Main Duct Velocity, m/s	Supply Velocity, m/s	Branch Duct Velocity, m/s	Run-out Duct Velocity, m/s	Return Duct Velocity, m/s
50		10.0	10.00		8.0	6.0	8.0
45		10.0	9.0		7.0	6.0	7.0
40		10.0	8.0		7.0	5.5	7.0
35		10.0	7.5		6.5	5.0	6.5
30		9.0	6.5		5.5	4.0	5.5

- Table above shows the duct velocities based on AES project experience
- **HOWEVER**, Project/Design Engineer must always check and select appropriate sizes to suit the project's complexity and application

Duct Fitting Pressure Loss

- Various duct fitting pressure losses
- AIRAH DA3 or the AIRAH Technical Handbook
- More available in the ASHRAE Handbook or SMACNA
- Obtain other duct fittings pressure losses from manufacturers such as duct heaters, dampers, filters, grilles, coils, etc
- Calculated by the following formula (derived from Bernoulli's)

$$\begin{aligned}\Delta P_{\text{TOTAL}} &= K_T \times P_V \\ &= K_T \times \frac{1}{2} \times \rho V^2\end{aligned}$$

ΔP_{TOTAL} = the total pressure loss across the duct fitting


K_T = the pressure loss coefficient of duct fitting

P_V = velocity pressure (dynamic pressure)

ρ = density of air

V = velocity of fluid

Example of Duct Fitting Loss

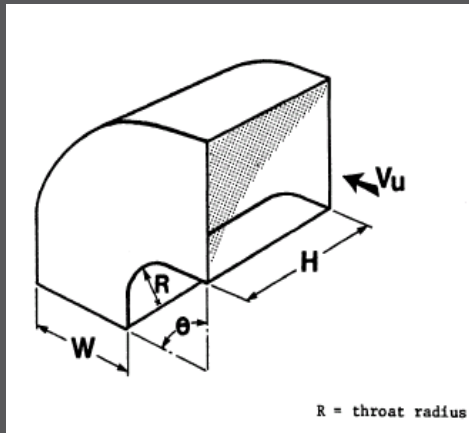

V_u = Upstream velocity of fitting

H = Height of the duct

W = Width of the duct

R = Radius of the bend

θ = Angle of the radius

ASPECT RATIO H/W	RADIUS RATIO R/W			
	0.25	0.5	1.0	1.5
0.25	0.57	0.27	0.22	0.20
0.5	0.52	0.25	0.20	0.18
0.75	0.48	0.23	0.19	0.16
1.0	0.44	0.21	0.17	0.15
1.5	0.40	0.19	0.15	0.14
2.0	0.39	0.18	0.14	0.13
3.0	0.39	0.18	0.14	0.13
4.0	0.40	0.19	0.15	0.14
5.0	0.42	0.20	0.16	0.14
6.0	0.43	0.21	0.17	0.15
8.0	0.44	0.21	0.17	0.15

BEND ANGLE θ°	BEND ANGLE CORRECTION
20	0.31
30	0.45
45	0.60
60	0.78
75	0.90
90	1.00
110	1.13
130	1.20
150	1.28
180	1.40

IHVE-HVRA

$k_T = k_T' \times k_{Re}$ k_{Re} = Reynolds No. correction.

$Re \times 10^{-4}$	1.0	2.0	3.0	4.0	6.0	8.0	10.0	14.0	≥ 20.0
k_{Re}	2.0	1.77	1.64	1.56	1.46	1.38	1.30	1.15	1.0

Calculate the pressure loss of the duct fitting in a 600mm W x 200mm H duct with a radius of 600mm and a 90° Bend angle. Say Reynolds number as 4500. Therefore the pressure loss is 0.2149

Example of an AES Static Calculation Sheet

- Can be summarised in a spreadsheet
- Remember to include other manufacturer's type ancillary duct fittings like duct heaters, VAVs, coils, etc
- Total static pressure safety various on application

FAN & DUCT STATIC CALCULATION SHEET														
Project Name										Pages		1 of 1		
Project No.										REVISION		DATE		
Consultant										ENGINEER				
Supplier														
Designation										AHU-4-1 & 2				
Location										LEVEL 4				
Sec duty				10979 / 8900		Pa		350		Actual		Pa		
										7		489		
DESCRIPTION	Qty	Length	Fittings	Duct size			Friction	Vel	Vel	Friction	TOTAL	FITTING		
/ ITEM		STR	No. of	W	H	DIA	P/100m	ms	press	coef	Pa	Pa	No.	
		m		mm	mm	mm		Vp	Kt					
RA REGISTER	1011		1.0	1200	600			1.5	1.4			20.0		
Straight D	1011	24.0		650	300		0.87	5.6				21.7		
90 R Bend	1011		5.0	650	300			5.6	18.8	0.30		28.3		
Transition	1011		1.0	650	300			5.6	18.8	0.21		4.0		
COMBINED FLOW	2290		1.0	1000	400			6.3	23.5	0.30		7.1		
Straight D	2290	7.0		1000	400		0.78	6.3				5.3		
90 R Bend	2290		3.0	1000	400			6.3	23.5	0.30		21.2		
Straight D	2290	1.5		1000	400			0.76	6.3			1.1	SUBDUCT	
Abt Expansion	2290		1.0	1000	400			6.3	23.5	0.46		10.8	RISER	
COMBINED FLOW	4851		1.0	2000	3000			0.9	0.4	0.30		0.1	LEVEL 1	
Straight D	4851	4.0		2000	3000		0.00	0.9				0.9		
COMBINED FLOW	9942		1.0	2000	3000			1.8	1.8	0.30		0.6	LEVEL 2	
Straight D	9942	4.0		2000	3000		0.02	1.8				0.1		
COMBINED FLOW	13209		1.0	2000	3000			2.3	3.3	0.30		1.0	LEVEL 3	
Straight D	13209	4.0		2000	3000		0.03	2.3				0.1		
Abt Contract	13209		1.0	1500	1200			7.7	35.8	0.48		16.5	LEVEL 4	
Motorised Damper	13209		1.0	1500	1200			7.7	35.8	0.25		8.9		
90 R Bend	13209		1.0	1500	1200			7.7	35.8	0.30		10.7		
DIVIDED FLOW	5763		1.0	1400	900			4.8	14.1	0.30		4.2		
Motorised Damper	5763		1.0	1400	900			4.8	14.1	0.25		3.5		
Straight D	5763	2.0		1400	900		0.25	4.8				0.5		
90 R Bend	5763		1.0	1400	900			4.8	14.1	0.30		4.2		
OBD Open	5763		1.0	1400	900			4.8	14.1	0.25		3.5		
Abt Expansion	5763		1.0	1400	900			4.8	14.1	0.46		6.5		
Filters											100.0		F6 DIRTY	
AHU-4-1														
Abt Contract	2212		1.0	1800	400			3.6	7.7	0.48		3.5	EDH 4-1	
Motorised Damper	2212		1.0	1800	400			3.6	7.7	0.25		1.9	FACE/BY	
90 R Bend	2212		1.0	1800	400			3.6	7.7	0.30		2.3		
HEATER BANK	2212		1.0	1800	400			3.6	7.7			10.0		
Straight D	2212	2.0		1800	400		0.19	3.6				0.4		
90 R Bend	2212		2.0	1800	400			3.6	7.7	0.25		3.9		
ATTENUATOR	2112		1.0	1800	400			3.4	7.0			15.0		
Straight D	2212	4.0		1800	400		0.19	3.6				0.8	RISER	
DIVIDED FLOW	1867		1.0	1600	400			3.3	6.7	0.30		2.0		
Straight D	1867	4.0		1600	400		0.18	3.3				0.7	RISER	
DIVIDED FLOW	944		1.0	600	300			5.6	19.1	0.30		5.7		
Straight D	944	4.0		600	300		0.91	5.6				3.6	RISER	
90 R Bend	944		1.0	600	300			5.6	19.1	0.25		4.8		
FIRE DAMPER	944		1.0	600	300			5.6	19.1			15.0		
Motorised Damper	944		1.0	600	300			5.6	19.1	0.25		4.8	SMOKE	
45 R BEND	944		2.0	600	300			5.6	19.1	0.18		3.9		
HEATER BANK	944		1.0	600	300			5.6	19.1			10.0		
Straight D	944	10.0		600	300		0.91	5.6				9.1		
Transition	944		2.0	600	300			5.6	19.1			0.0		
Transition	738		1.0	550	300			4.8	13.7			0.0		
90 R Bend	738		1.0	550	300			4.8	13.7	0.30		4.1		
Straight D	738	3.0		550	300		0.68	4.8				2.1		
Transition	635		1.0	400	300			8.6	18.7			0.0		
Straight D	635	8.0		400	300		1.08	8.6				8.7		
Transition	429		1.0	300	250			6.0	21.7			0.0		
Straight D	429	10.0		300	250		1.59	6.0				15.9		
VA REGISTER	120		1.0			250		2.4	3.6			25.0		
NOTES:											SAFETY %		SUB TOTAL	
											4		436	
											TOTAL		489	
AHU FILTERS: 48Pa CLEAN + 50Pa DIRTY											SUPPLIER		MODEL No.	
											MODEL SPECIFIED			
											MODEL SELECTED			


Installation Do's and Don'ts

- Good resource - “Fans by Fantech Book”




Installation Do's and Don'ts by Fantech


X Don't

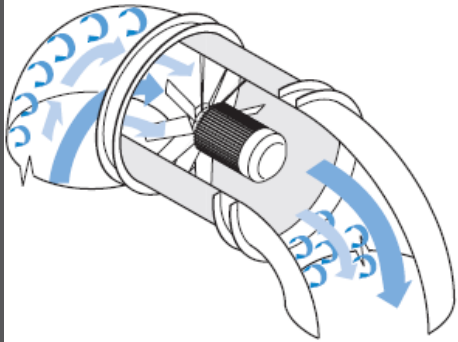


✓ Better

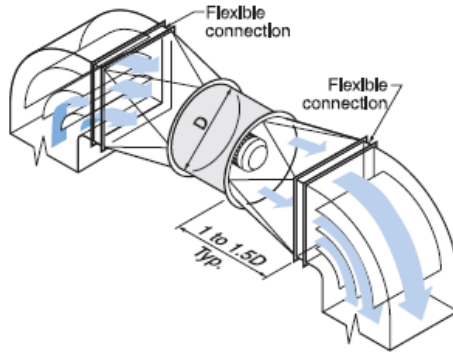


X Don't

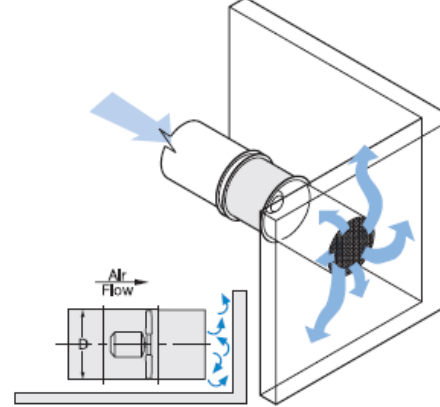


✓ Do

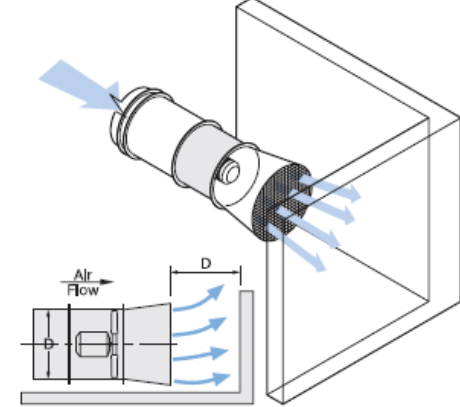


X Don't

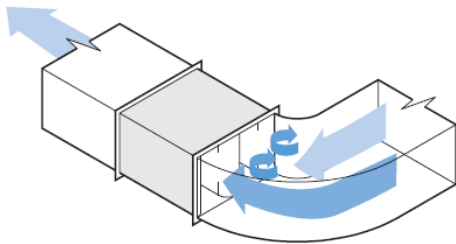


✓ Do

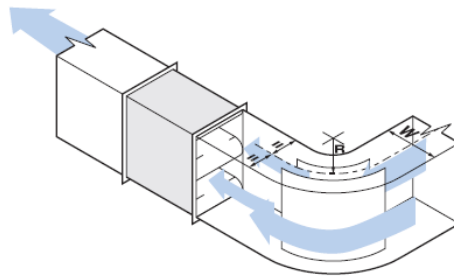

X Don't

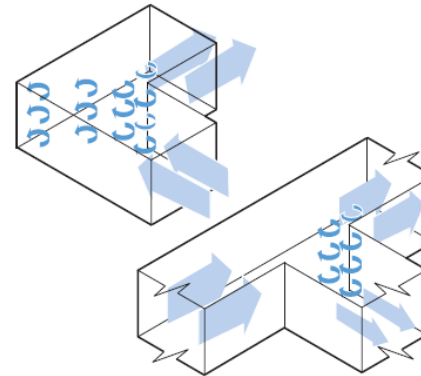

✓ Do

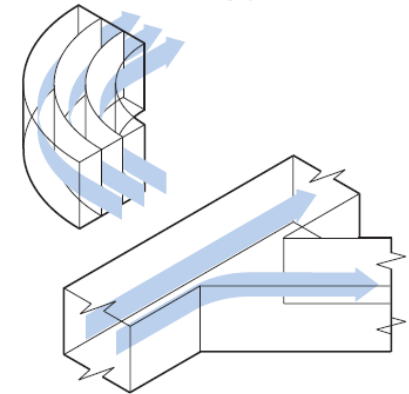


Duct Applications

- Kitchen Exhaust Ductwork
- Smoke Exhaust Ductwork
- Seismic Restraining
- Winds Restraining (not covered in this presentation)
- Acoustics and Attenuation (refer to Back to Basics: Acoustics held last Technical Meeting)
- Etc


Kitchen Exhaust Ductwork

- Construction of 1.2mm or 0.9 stainless as per AS1668 standard with Seams sealed to prevent grease leakage.
- Spigot connections at 5 to 7m/s. Duct to slope up in direction of flow for grease flow back to hood.
- Duct access panels every 3 metres of straight duct and change of direction. Builder/Architect must provide access panels.
- Lower edge of canopy type must not be less than 2m above floor level at the operator side of cooking equipment.

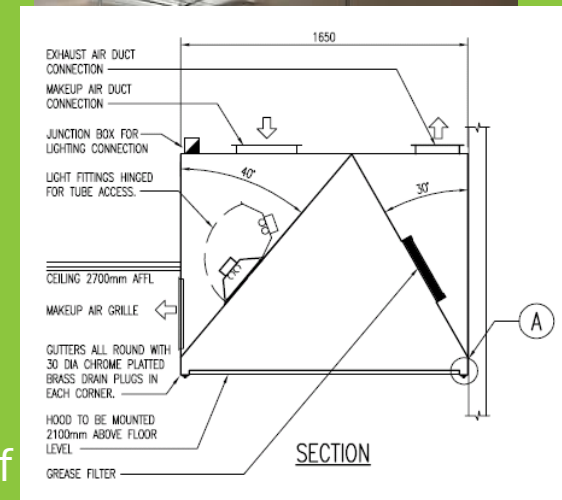


Smoke Exhaust Ductwork

- Internal insulated smoke exhaust ductwork must have perforated metal lining
- Coated with fire rated spraying/wrapping, cladding and etc must applied where smoke exhaust ductwork in a different fire compartment it serves
- Construction of 1.2mm galvanised steel or 0.9mm stainless steel thick ductwork. Subducts are 2mm ductwork and fully welded at each level to prevent smoke migration between non fire affected floors. Riser shafts adequately sized to allow for restrictions.

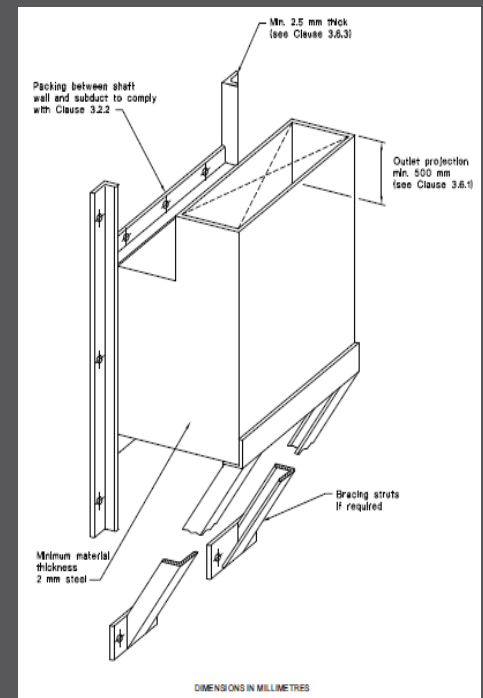

Seismic Restraints

- Requirements determined by AS 1170.4-2007 and not clear in design documents.
- Building Structural Engineer and Building Certifier to classify the following:-
 - Earthquake Design Category
 - Building Importance
 - Probability of Exceedance of design event and Probability factor
 - Hazard Factor
 - Site Sub Soil Classification
- Duct installed to be reviewed initially and finally by structural engineer (project or independent) prior to completion

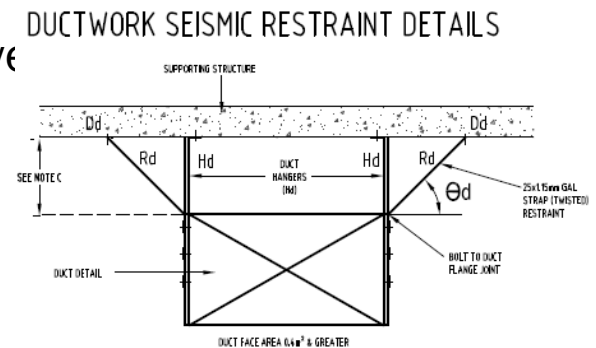

AS4254: Duct Classification Standard

- Duct pressure classification tables found in the AS 4254 such as low, medium or high pressure
- AS4254 explains duct thicknesses, sealing, reinforcement and functional requirements. Refer to table 2.3 for duct thicknesses and reinforcement methods
- Changes to 2012 edition as follows:
 - Fire rated duct must be constructed to the same standard as the tested solution for that particular product. Detail must be obtained from the relevant supplier at the start of the project and may be different depending on the proposed fire rating method.
 - Any duct system over 3000 L/s must be tested at minimum 10% of each system at 1.25 times operating pressure.

Thank You